



- DP1 REMOVE TOILET AND ASSOCIATED PLUMBING BACK TO SOURCE.
- DP2 REMOVE URINAL AND ASSOCIATED PLUMBING BACK TO SOURCE.
- DP3 REMOVE SINK AND REMOVE ITS ASSOCIATED PLUMBING BACK TO SOURCE.
- DP4 REMOVE FLOOR DRAIN AND ASSOCIATED PLUMBING BACK TO SOURCE.
- DP5 REMOVE SHOWER VALVE ASSEMBLY AND ASSOCIATED PLUMBING BACK TO SOURCE.
- DP6 REMOVE APOLLO TUB AND ASSOCIATED PLUMBING BACK TO SOURCE. TUB IS TO BE STORED FOR REUSE IN NEW BATHROOM.
- DP7 DISCONNECT VENT LINE FROM SINK AND RECONNECT TO EXISTING VENT LINE IN PIPE CHASE.
- DP8 REMOVE SHOWER MIXING VALVES AND ALL ASSOCIATED PLUMBING.
- DP9 REMOVE SHOWER CLOSET AND ASSOCIATED PLUMBING BACK TO SOURCE.
- DP10 NOT USED.
- DP11 REMOVE TOILET CARRIERS AND RECONNECT WASTE LINE THRU FLOOR.
- DP12 REMOVE WATER LINES TO SOURCE.

1.0 FIRST FLOOR PLUMBING DEMOLITION SCALE: 1/8" = 1'-0"

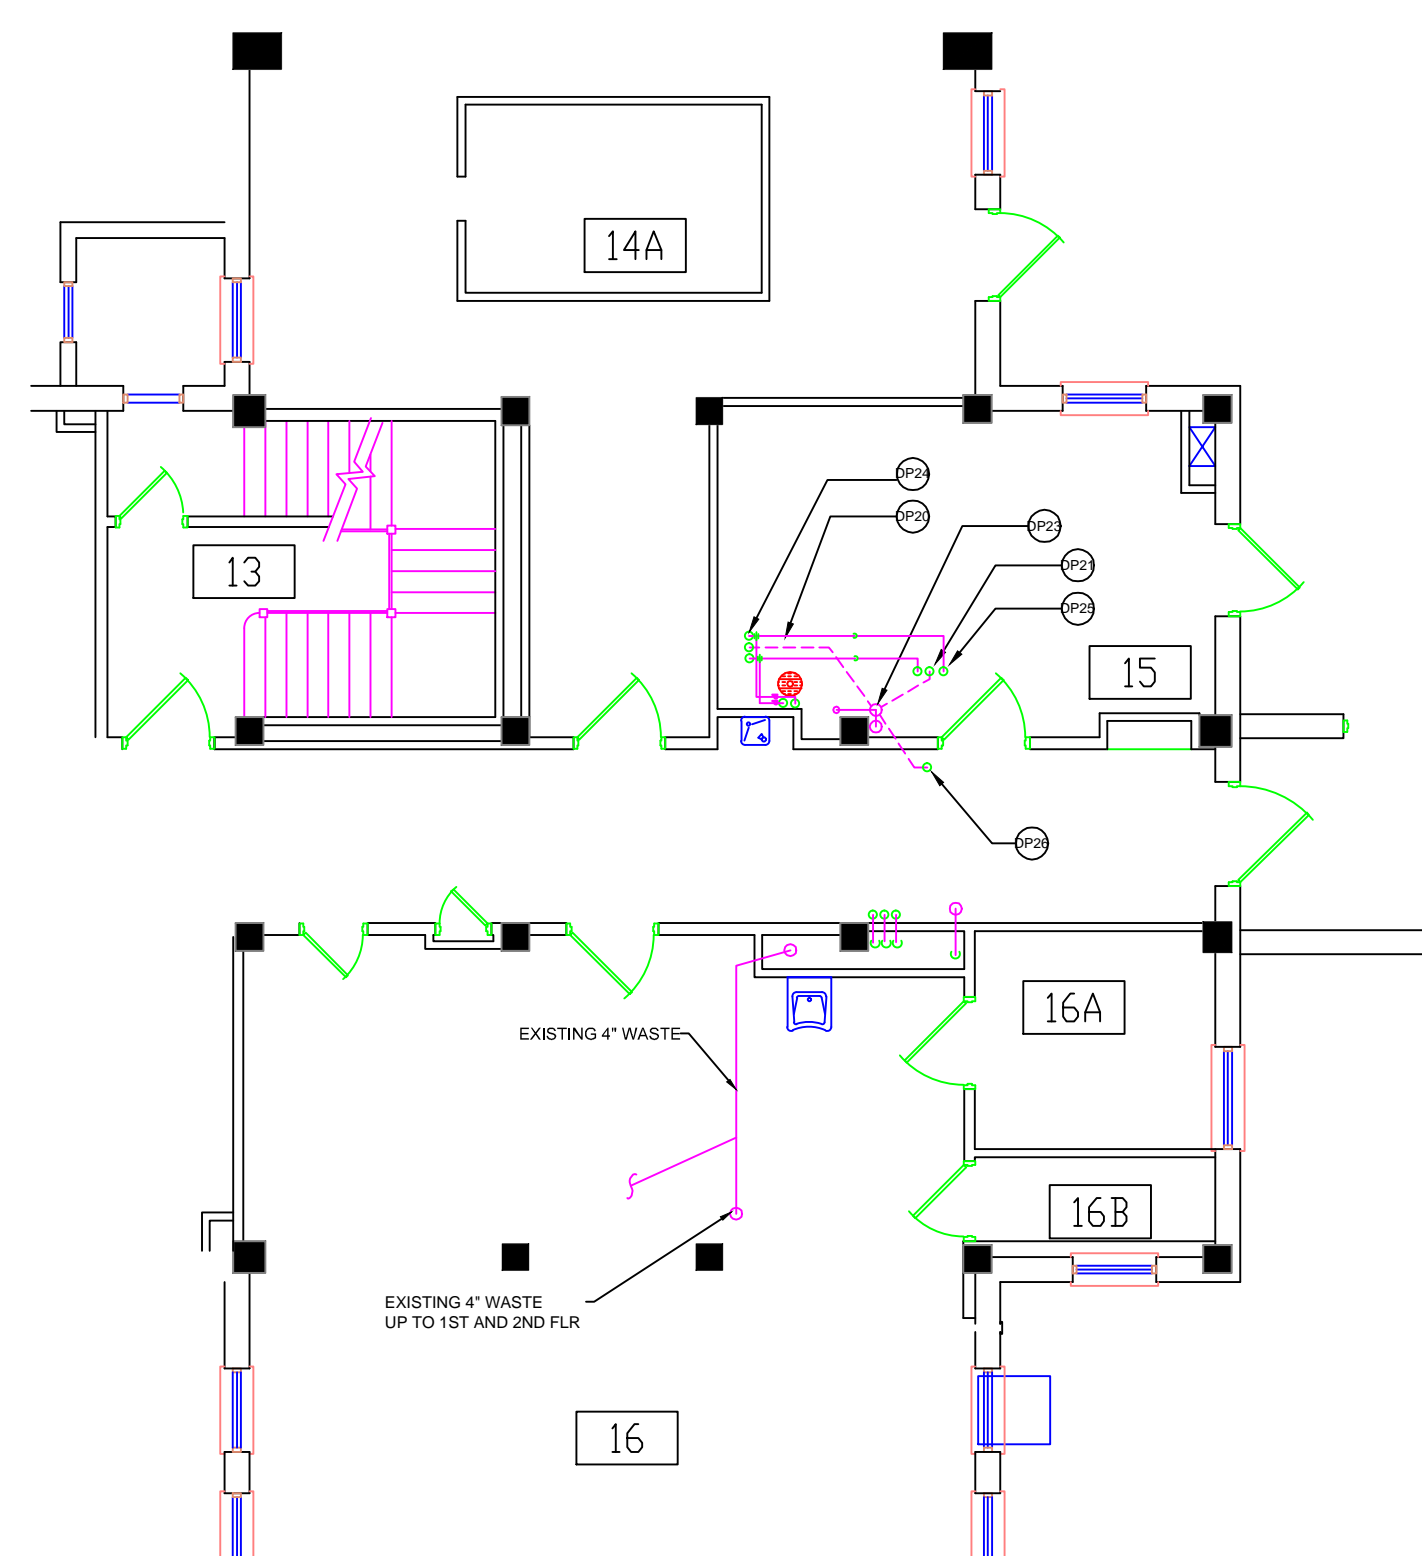


- DP20 REMOVE WASTE LINE DOWN FROM SINK BACK TO SOURCE - CORE FILL HOLE.
- DP21 REMOVE WASTE LINE DOWN FROM TUB BACK TO SOURCE - CORE FILL HOLE.
- DP22 REMOVE WASTE LINE DOWN FROM SHOWER BACK TO SOURCE - CORE FILL HOLE.
- DP23 REMOVE 3" WASTE LINE DOWN FROM FIRST FLOOR - TO BE REPLACED WITH 4" AT PANNING OF FIRST FLOOR DOWN THROUGH CRAWL SPACE TO EXISTING 4" WASTE PIPE.
- DP24 REMOVE WATER LINES FROM SINK AND CAP AT SOURCE CORE FILL HOLES.
- DP25 REMOVE WATER LINES FROM TUB AND CAP AT SOURCE CORE FILL HOLES.

1.2 BASEMENT LEVEL PLUMBING DEMOLITION SCALE: 1/8" = 1'-0"

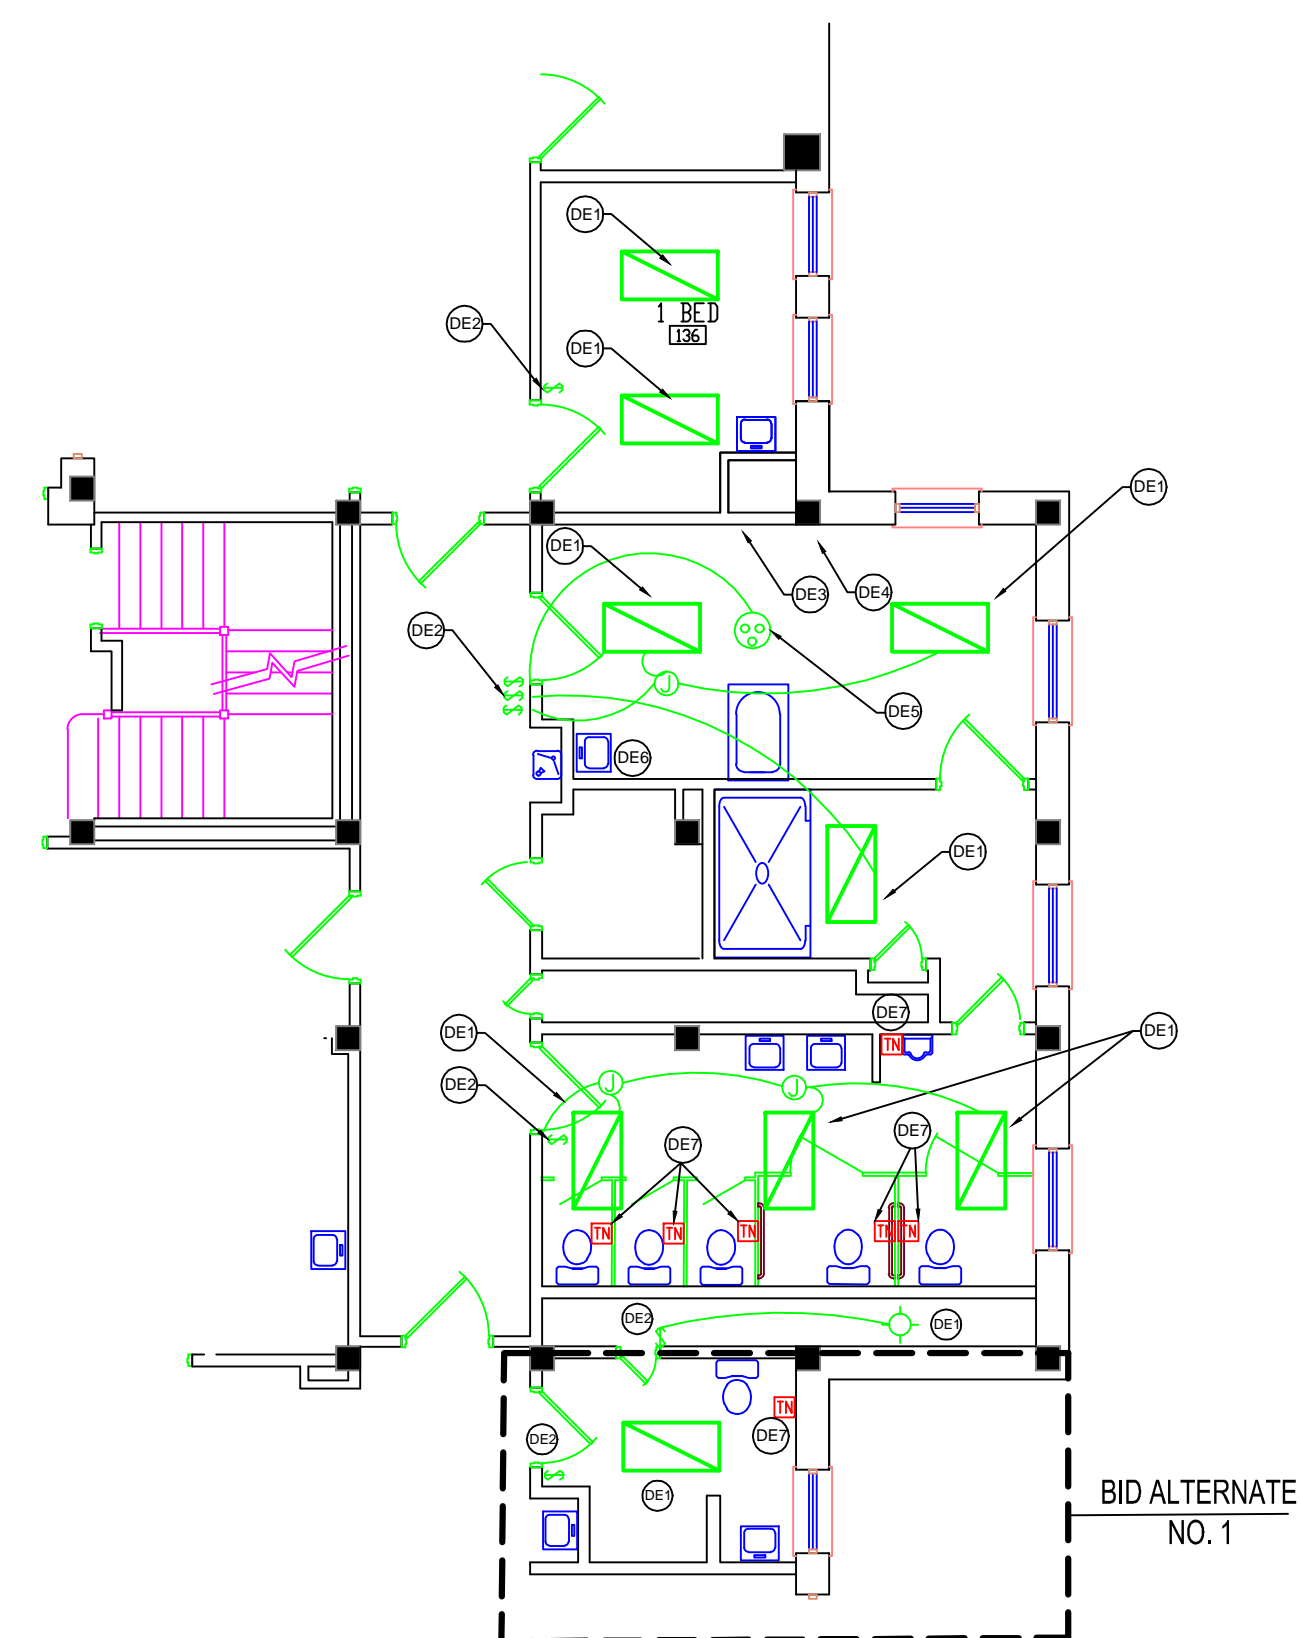


- DE1 REMOVE LIGHT AND ASSOCIATED WIRES, CONDUIT AND ANCHORS.
- DE2 REMOVE LIGHT SWITCHES AND ASSOCIATED WIRES, CONDUIT AND GANG BOX BACK TO SOURCE.
- DE3 REMOVE ELECTRICAL OUTLET STRIP AND ASSOCIATED WIRES AND CONDUIT BACK TO SOURCE.
- DE4 REMOVE FLORESCENT LIGHT STRIP AND ASSOCIATED WIRES AND CONDUIT BACK TO SOURCE.
- DE5 REMOVE DOME LIGHT AND ALL ASSOCIATED WIRES AND CONDUIT BACK TO SOURCE.
- DE6 REMOVE EMPTY GANG BOX AND ASSOCIATED CONDUIT.
- DE7 REMOVE NURSE CALL SWITCH AND ASSOCIATED WIRES AND CONDUIT. SAVE SWITCH FOR REINSTALLATION.
- DE8 SUPPORT EXISTING NURSE CALL HEAD END EQUIPMENT DURING DEMOLITION - TO BE REINSTALLED.

1.4 DEMOLITION ELECTRICAL SCALE: 1/8" = 1'-0"

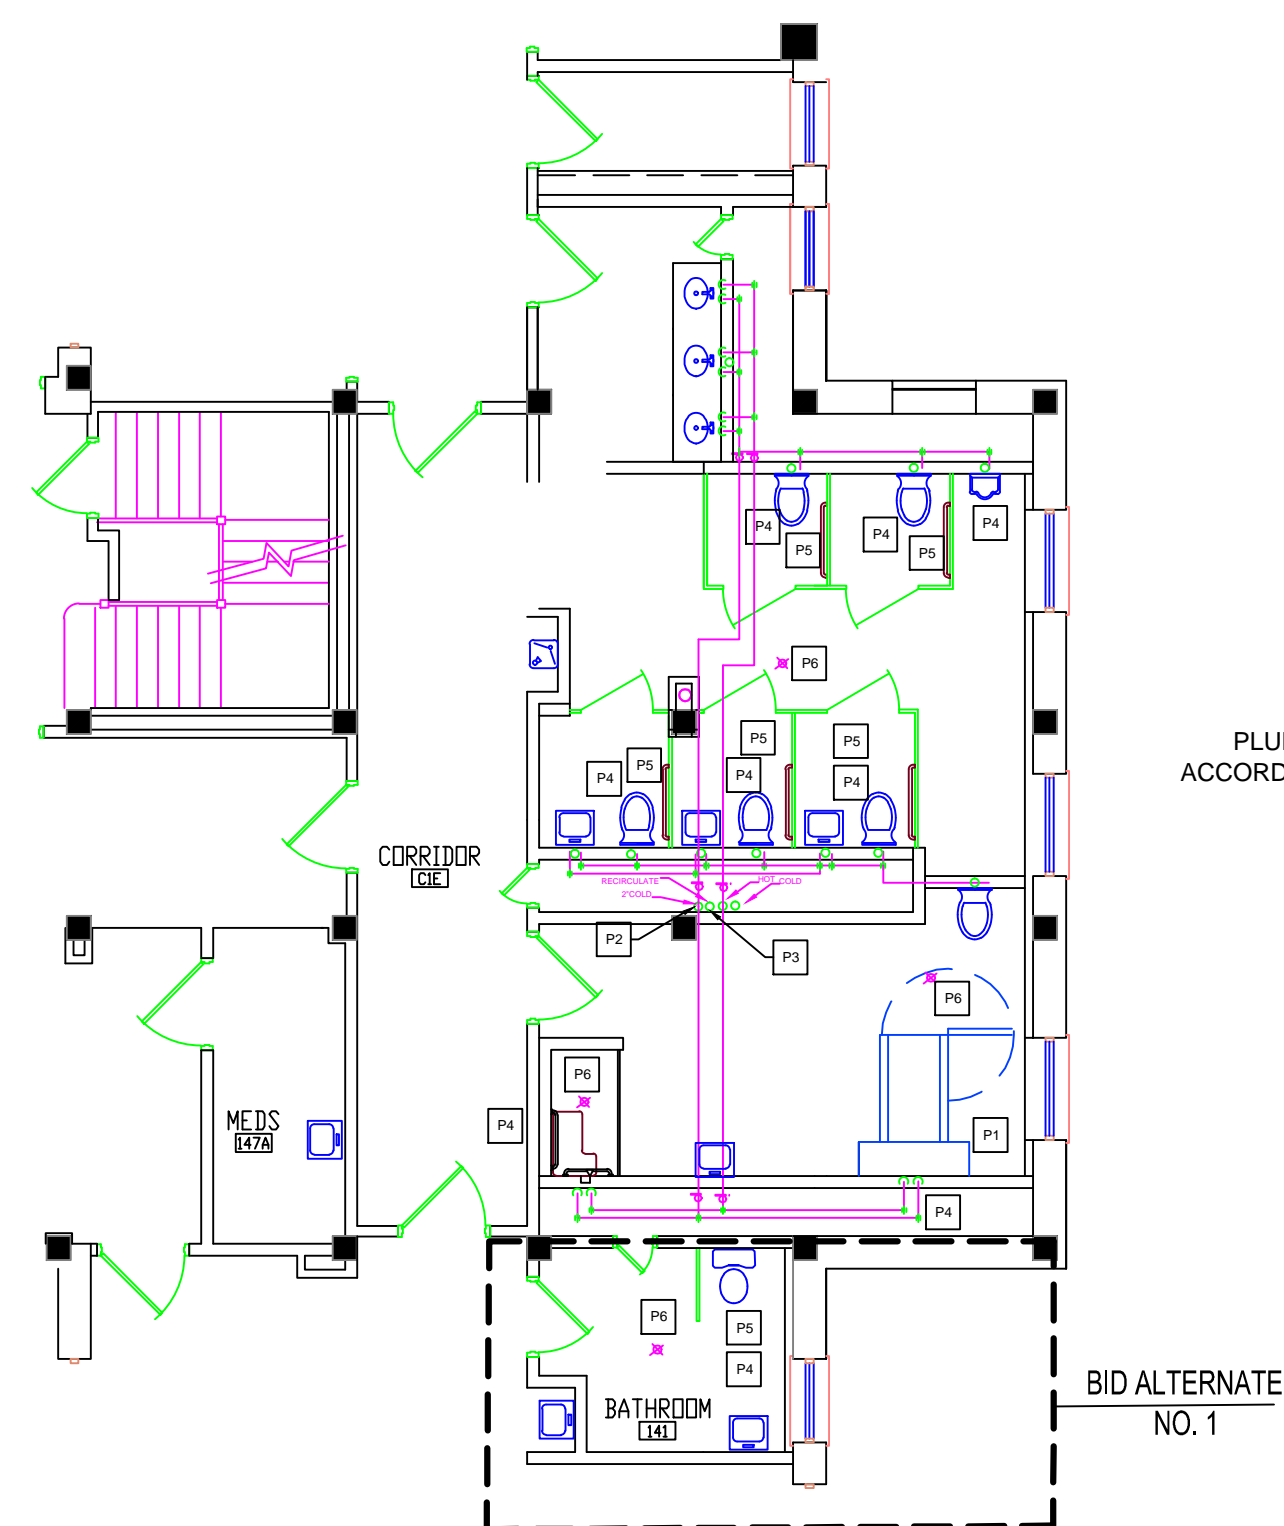

- P1 VERIFY INSTALLATION PROCEDURES AND REQUIREMENTS OF APOLLO TUB. CONTRACTOR IS TO COORDINATE WITH VA.
- P2 INSTALL NEW 2" COLD WATER COPPER LINE FROM BELOW 1ST FLOOR PENETRATION TO CONNECTION AT 2ND FLOOR.
- P3 INSTALL NEW 2" HOT WATER AND RE-CIRCULATE COPPER LINE FROM BELOW 1ST FLOOR PENETRATION TO CONNECTION AT 2ND FLOOR.
- P4 INSTALL NEW SUPPLY LINES AND WASTE LINE TO FIXTURE.
- P5 INSTALL BARIATRIC CARRIERS FOR WALL HUNG TOILET - TOILET SHALL BE LOW FLOW TYPE.
- P6 INSTALL NEW FLOOR DRAIN AND ASSOCIATED PLUMBING.


1.1 FIRST FLOOR PLUMBING SCALE: 1/8" = 1'-0"

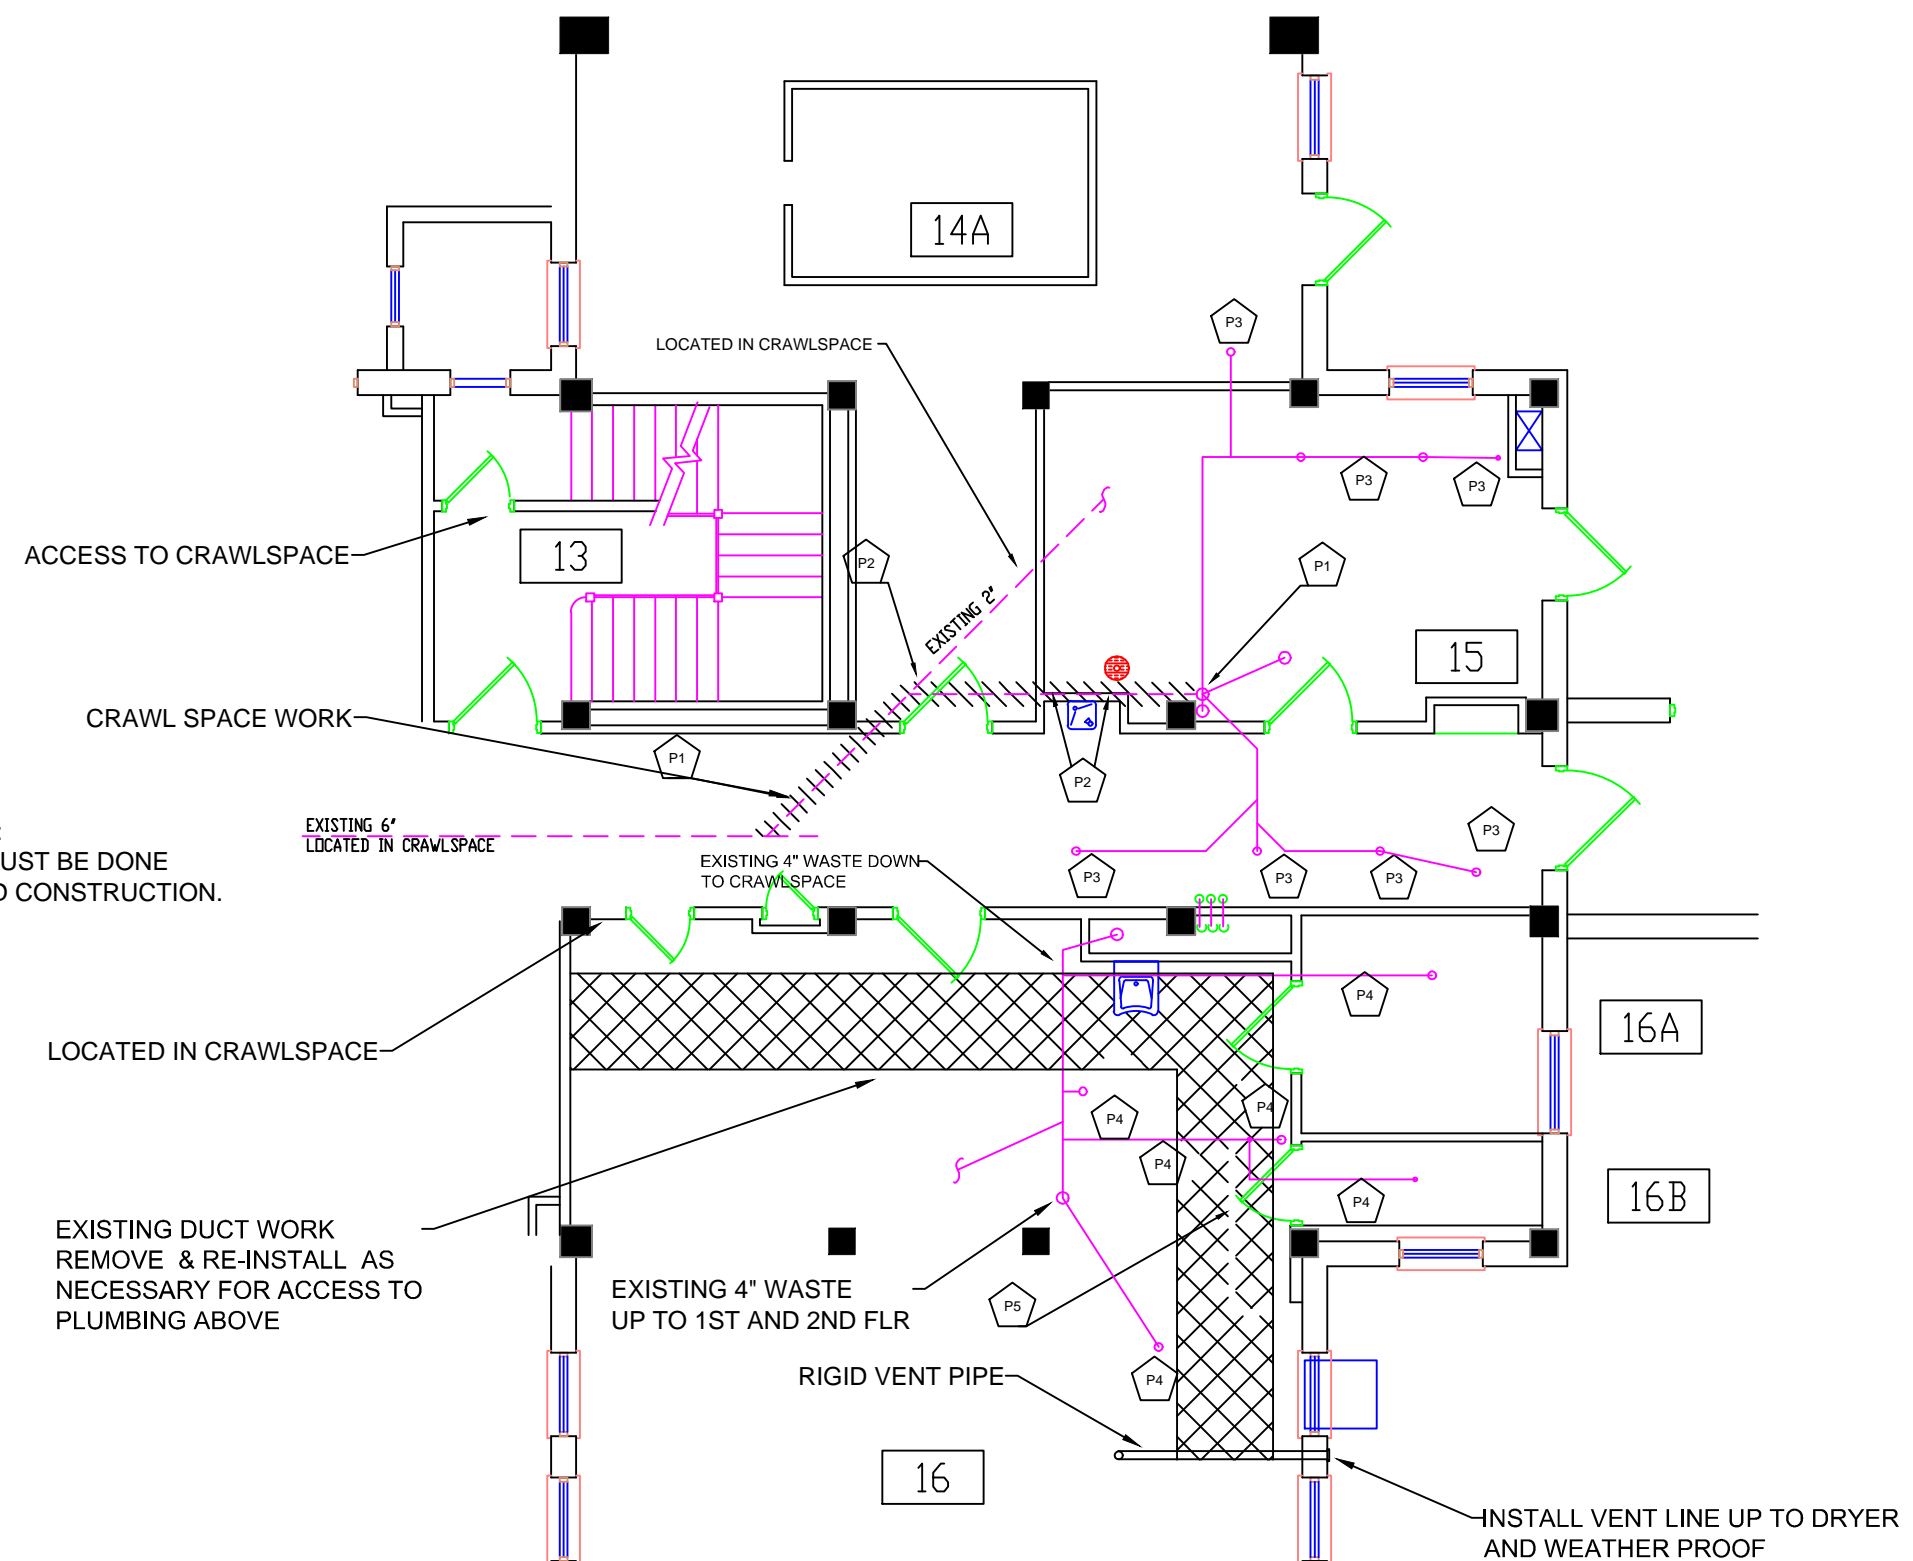

- P1 PROVIDE NEW 4" WASTE, TO EXTEND FROM PANNING OF 2ND FLOOR THROUGH BASEMENT LEVEL AND TIE IN AT EXISTING 6" WASTE IN CRAWLSPACE.
- P2 TIE IN EXISTING 2" WASTE LINE TO NEW 4" WASTE IN CRAWL SPACE.
- P3 NEW 4" WASTE FROM FIXTURE ABOVE.
- P4 NEW 2" WASTE FROM FIXTURE OR DRAIN ABOVE.
- P5 PROVIDE NEW DRYER VENT FROM FIRST FLOOR TO EXTERIOR.

FOR FLOOR DRAIN DETAIL, SEE 1.4/5

1.3 REFLECTIVE CEILING BASEMENT LEVEL PLUMBING SCALE: 1/8" = 1'-0"

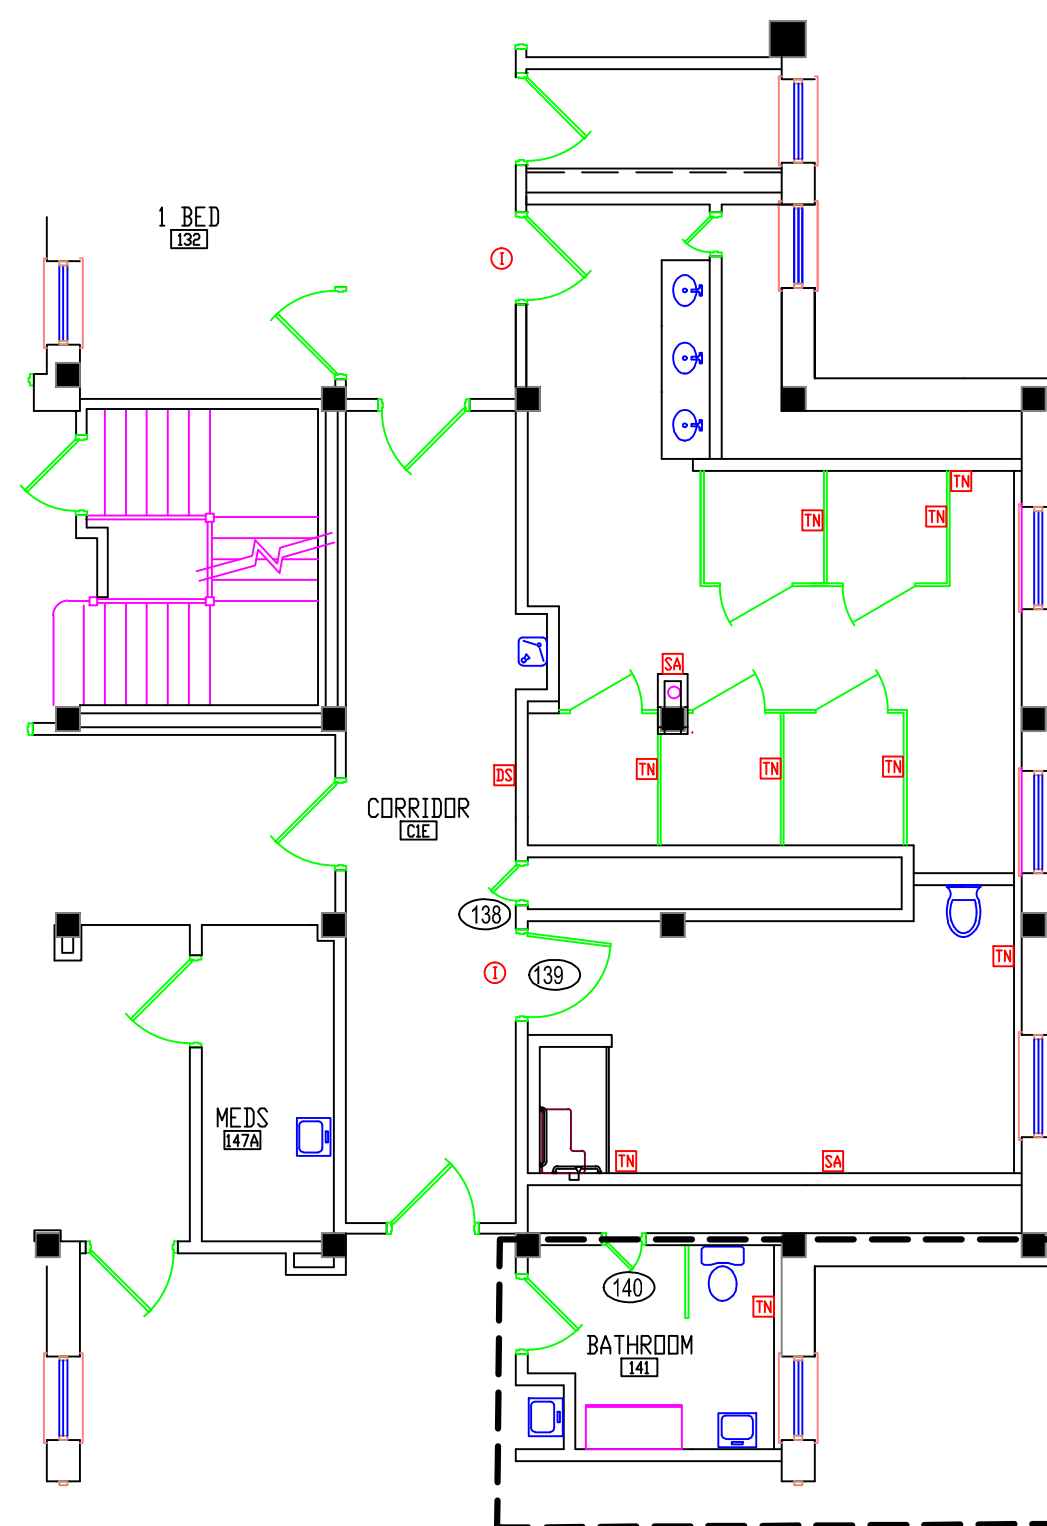


NURSE CALL NOTES

1. NURSE CALL MUST REMAIN FUNCTIONAL IN ALL AREAS NOT UNDER CONSTRUCTION.
2. HEAD END EQUIPMENT MUST BE PROTECTED AND SUPPORTED APPROPRIATELY DURING DEMOLITION AND CONSTRUCTION.
3. PROVIDE NEW CONNECTIONS FROM PULL/CALL LOCATIONS TO CEILING MOUNTED LIGHTS, HEAD END EQUIPMENT AND MAIN NURSE PANEL.
4. PROVIDE WATER PROOF NURSE CALL EQUIPMENT IN BATHROOM AND TUB/SHOWER LOCATIONS.
5. ALL EQUIPMENT IS TO BE INSTALLED PER SPECIFICATIONS AND MANUFACTURERS RECOMMENDATIONS.
6. NEW EQUIPMENT IS TO MATCH EXISTING. CONTRACTOR TO VERIFY REQUIREMENTS OF EXISTING RAULAND RESPONDER 4000 SYSTEM.

- WATER PROOF TOILET STATION WITH PULL CORD.
- STAFF ASSIST BUTTON.
- DOME LIGHT INDICATOR.
- DUTY STATION.

1.5 NURSE CALL SCALE: 1/8" = 1'-0"

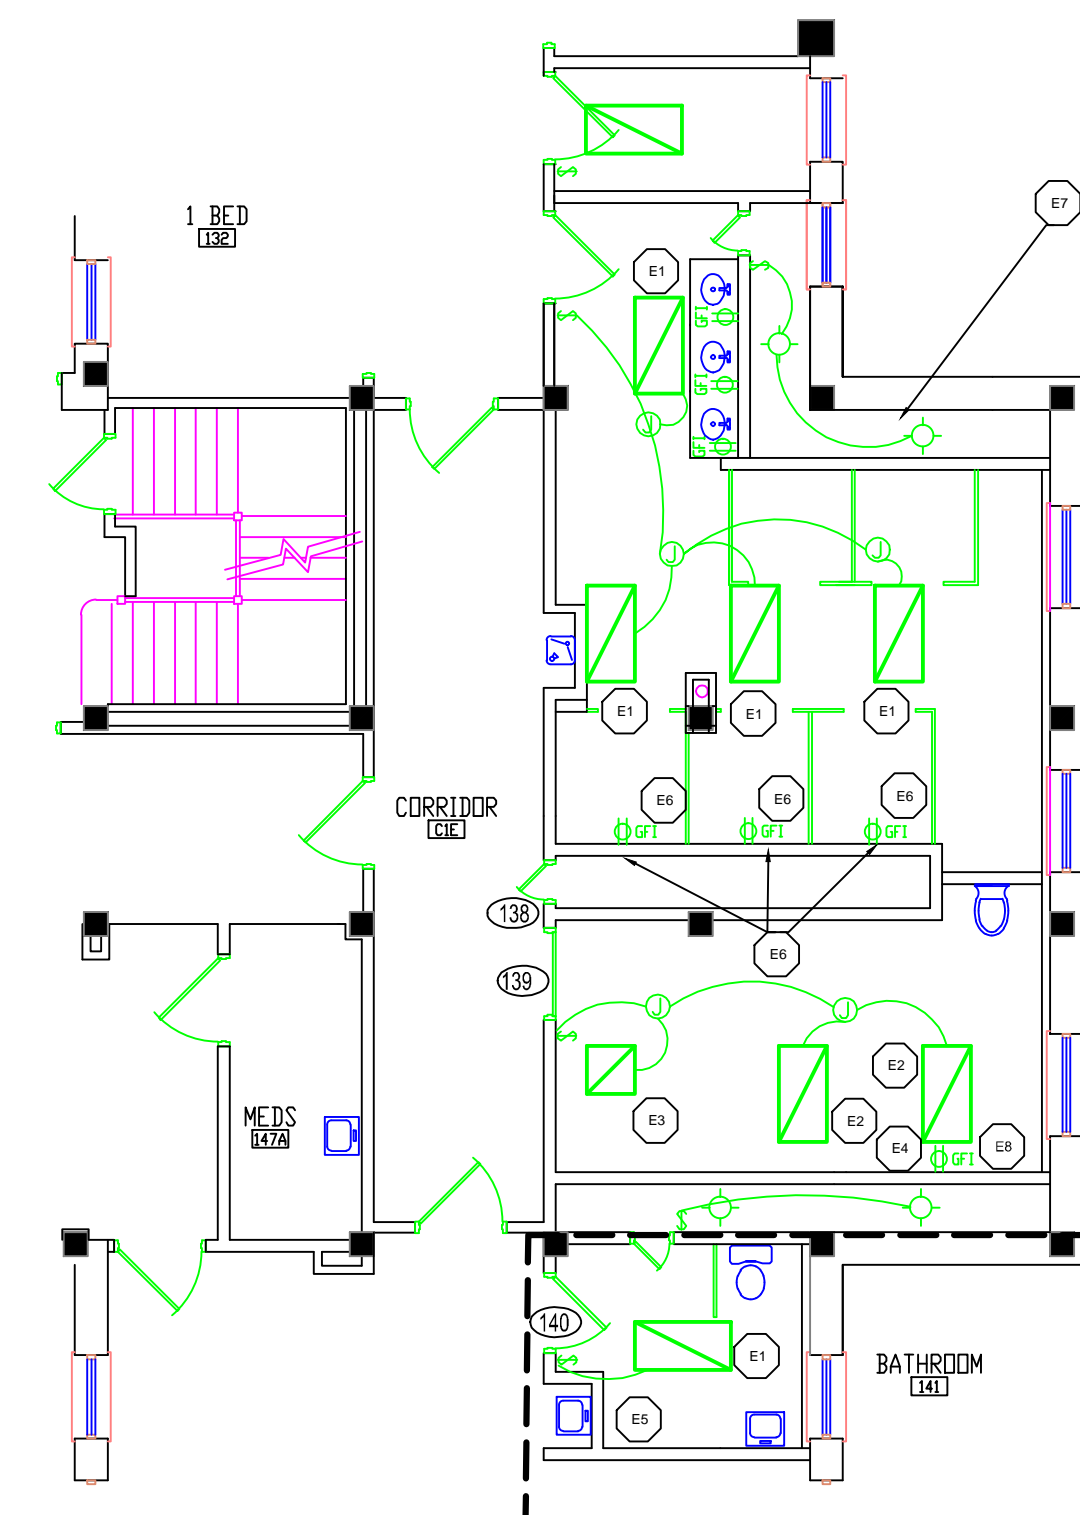

- E1 PROVIDE NEW 24" x 48" LIGHT FIXTURE ACCORDING TO SPECIFICATIONS.
- E2 PROVIDE NEW 24" x 48" MOISTURE RESISTANT LIGHT FIXTURE PER SPECIFICATIONS.
- E3 PROVIDE NEW 24" x 24" MOISTURE RESISTANT LIGHT FIXTURE PER SPECIFICATIONS.
- E4 PROVIDE GFI DUPLEX RECEPTACLE FOR WASHING MACHINE.
- E5 PROVIDE RECEPTACLE FOR DRYER.
- E6 PROVIDE GFI OUTLET ABOVE COUNTER TOP HEIGHT.
- E7 PROVIDE ELECTRICAL CONNECTION TO EXHAUST FAN, COORDINATE WITH MECHANICAL CONTRACTOR FOR SPECIFICATIONS ON FAN.
- E8 PROVIDE 120V 20AMP CIRCUIT FOR APOLLO TUB - CONTRACTOR TO COORDINATE WITH VA.

1.6 ELECTRICAL SCALE: 1/8" = 1'-0"

| No | REVISION | DATE |
|----|----------|------|
| | | |

RENOVATE BUILDING 48 ADHC BATHROOMS

| | | | |
|-----------------------------------|------|----------------------------------|------|
| APPROVED SERVICE LINE DIRECTOR | DATE | APPROVED INFECTION CONTROL NURSE | DATE |
| APPROVED SEAS COORDINATOR | DATE | APPROVED PATIENT SAFETY | DATE |
| APPROVED PROJECTS SECTION MANAGER | DATE | APPROVED CHIEF OF POLICE | DATE |
| APPROVED DIRECTOR FMS | DATE | APPROVED SAFETY MANAGER | DATE |

| | |
|-------------------------------------|----------|
| DRAWING TITLE | DATE |
| BUILDING 48 PLUMBING AND ELECTRICAL | 06/21/11 |

| | |
|--|----------|
| PROJECT TITLE | DATE |
| BUILDING 48 ADULT DAY HEALTHCARE BATHROOM RENOVATION | 06/21/11 |

| | |
|---------------------------------|------------------------------------|
| ST. CLOUD VA Health Care System | Brainerd Montevideo Alexandria |
|---------------------------------|------------------------------------|